

PARAMETRI CHIMICI

Parametrul	1	2	3	4	Valoarea maxima admisa	Metoda de analiza
FLUORURI(mg/l)					1.5	SR ISO 10539-1: 2001
NITRITI-NO ₂ (mg/l)	0				0.5	SR EN 26777:2002 /C91:2006
NITRATI-NO ₃ (mg/l)					50	SR ISO 7890-3: 2000
CULOARE					Acceptabila pt. consumatori si fara modificari anormale	SR EN ISO 7887: 2012 (Sectiunea 2)
pH (unitati de pH)/T°C	7.98/21.4°C	7.95/21.4°C			≥6,5; ≤9,5	SR ISO 10523: 2012
TURBIDITATE (U.N.T)	Fara modificari anormale				Acceptabila pt. consumatori si fara modificari anormale	SR EN ISO 7027 : 2016
CONDUCTIVITATE μs/cm ⁻¹ la 20°C	1012				2500	SR EN 27888 : 1997
AMONIU, NH ₄ ⁺ (mg/l)	0.068	0.054			0,5	SR ISO 7150-1 : 2001
CLORURI (mg/l)	198.11	182.71			250	SR ISO 9297 : 2001
OXIDABILITATE mg O ₂ /l (Indice de permanganat)	0.96	1.50			5	SR EN ISO 8467 : 2001
MANGAN(μg/l)					50	SR ISO 6333 : 1997
FIER(μg/l)					200	SR ISO 6332 : 1996
SULFATI(mg/l)					250	STAS 3069 : 1987
DURITATE TOTALA Suma de calciu si magneziu (grade germane)		17.36			min. 5	SR ISO 6059 : 2008
CLOR REZIDUAL Liber/Total mg/l	0.42/0.44	0.32/0.34			≥0.1-≤0.5	SR EN ISO 7393-1:2002
BOR mg/l					1.5	SR ISO 9390:2000

DECIZIE	Probele corespund ORD nr. 7/ 18.01.2023, pentru parametrii analizati: DA
----------------	---


Rezultatele se refera numai la probele analizate.
 Opiniile si interpretarile continute de prezentul raport nu sunt acoperite de acreditare RENAR
 Buletinul nu poate fi reprodus decit integral fara aprobarea laboratorului
 Cod BA-12-01 Ed 1.Rev 0/09.2019

Analize efectuate de:

Executant / As.Pr.Popescu Ruxandra
 As. Pr. Soava Marius
 As. Pr. Coscai Georgeta

Biochimist med. Pr
 Bobrec Georgeta

Responsabil de analiza
 Chimist specialist
 Pacurariu Liliana

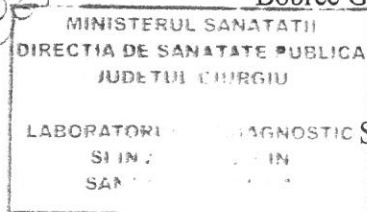

Aprobat,
 Sef Laborator /Medic Primar
 Dr. Neagu Mirela